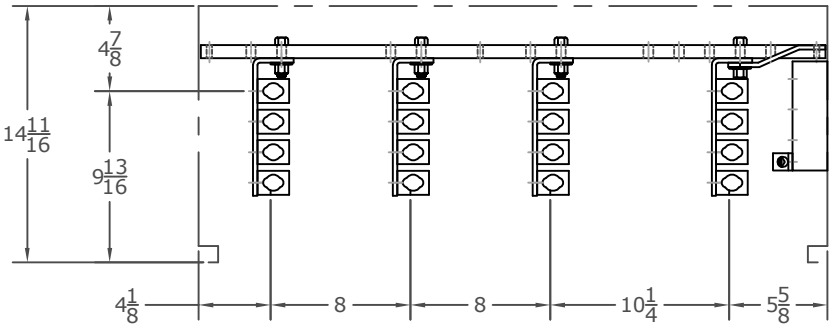

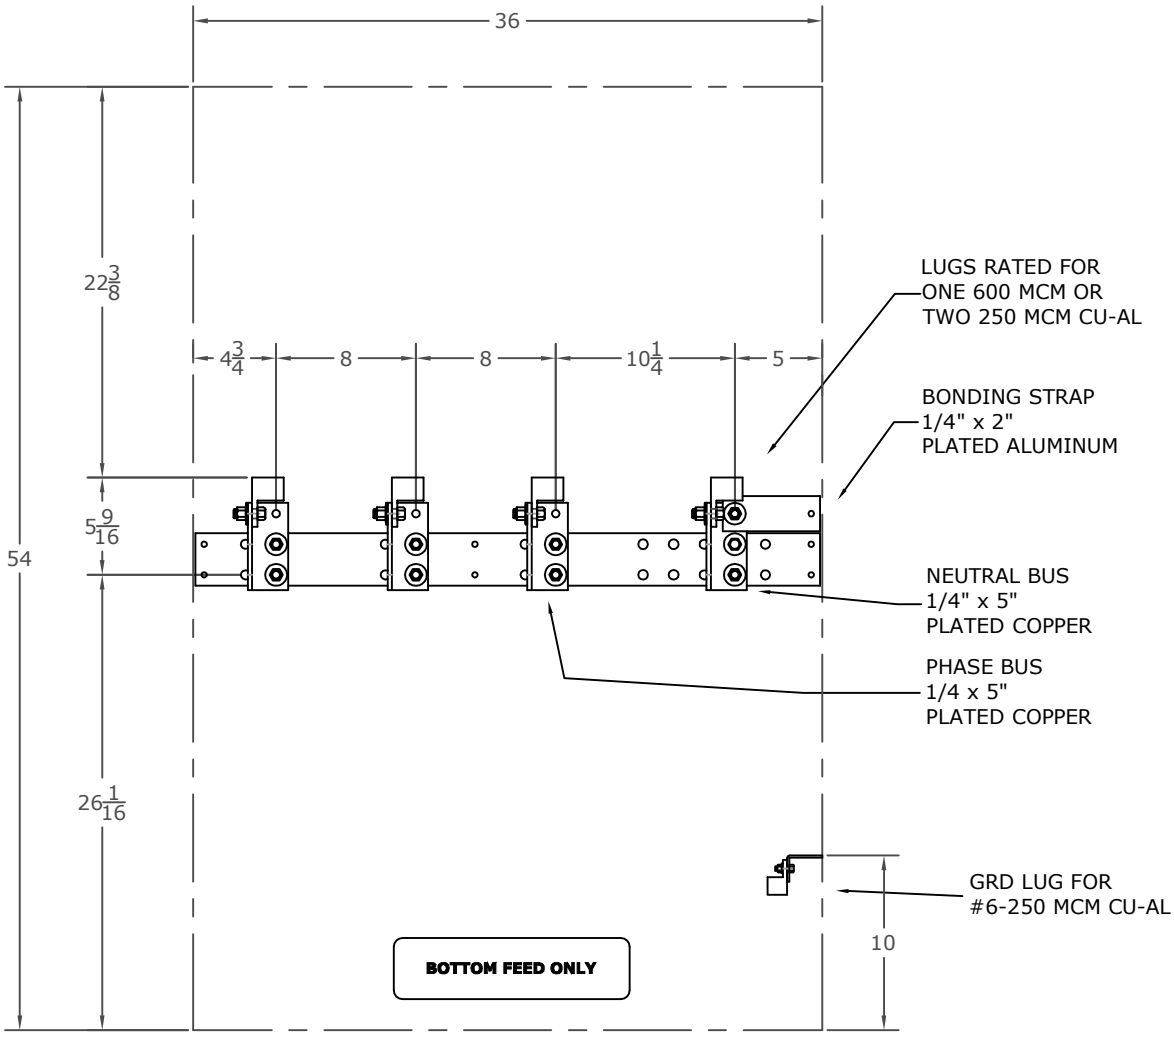

NOTES:

1. 3Ø 4-WIRE SHOWN
2. FOR 3Ø 3-WIRE, NEUTRAL BUS IS OMITTED.
3. 65,000 AMP SHORT-CKT RATING
4. 0.125" ALUMINUM CABINET
5. UL LISTED

106
604

TB-1200-4

REVISIONS		
NO	DATE	BY
1	05/16/96	RCE
2	01/21/97	RCE
3	08/19/99	KAP
4	06/07/00	KAP
5	08/26/02	KAP
6	02/01/07	KRE

RJB

GALVA-CLOSURE PRODUCTS CO.

STOUGHTON, WISCONSIN

1200 AMP TERMINATION BOX ~
IN AC543614

DR BY	DATE	APP'D BY	DR NO.
RCE	12/18/95	RCE	20103-805